



Refer to the User's Guide for full instructions.


MOTION AND PRESENCE SENSOR FOR AUTOMATIC SLIDING DOORS

Software version 6.3 / Configuration 42.4463.03
(refer to Admin menu for product software version)


READ BEFORE BEGINNING INSTALLATION & SETUP




The sensor should be mounted securely to avoid extreme vibrations.




Do not cover the sensor.



Avoid moving objects and light sources in the detection field.




Avoid highly reflective objects in the infrared field.




The door control unit and the header cover profile must be correctly grounded.



Only trained and qualified personnel are recommended for installation and setup of the sensor.



Following installation, always test for proper operation (according to ANSI 156.10) before leaving the premises.




The warranty is invalid if unauthorized repairs are made or attempted by unauthorized personnel.

This device can be expected to comply with Part 15 of the FCC Rules, provided it is assembled in exact accordance with the instructions provided with this kit. Operation is subject to the following conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

1 MOUNTING & WIRING

Refer to Application Note 76.0035 if an IXIO Spacer is required for the given application.

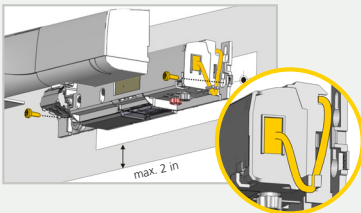

Sensor connectivity (power and relays) must utilize only the supplied harness.

Sensor power and camera must be supplied from a Class 2 supply source limited to 15 W.

Sensor is intended to be monitored for proper operation by the door operator or system.


Harness shall be routed separated from any Mains or non-Class 2 voltage cable for correct operation or shall be rated for the Mains voltage, and suitable protection and routing means shall be used according to National and Local Codes to prevent damage to the harness and/or IXIO sensor.

SENSOR		DOOR CONTROL	
RED	POWER SUPPLY		
BLACK	POWER SUPPLY		
BROWN	SAFETY INPUT		
BLUE	SAFETY INPUT		
WHITE (COM)	OPENING INPUT		
YELLOW (N.C)	OPENING INPUT		
GREEN (N.O.)	OPENING INPUT		
PURPLE	TEST OUTPUT*		
PURPLE	TEST OUTPUT*		

POWER
12 – 24 VAC/DC
12 – 30 VDC
2.5 W (max)


TEST
low: < 1 V
high: > 10 V (30 V max.)
response time: typ. < 5 ms

CAMERA HARNESS FOR DT1 V

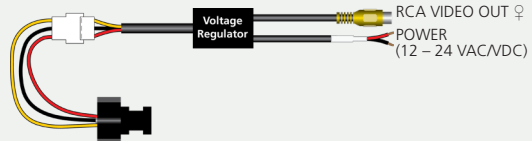


2 RADAR OPENING IMPULSE FIELD

ANGLE




TILT




ROTATE

WIDTH




WIDE





NARROW

3 INFRARED SAFETY FIELD

ANGLE




Activate the visible spots.



Adjust the angle, if necessary.

WIDTH

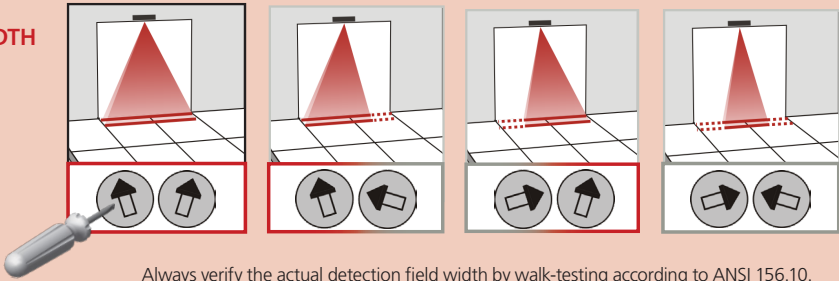

Always verify the actual detection field width by walk-testing according to ANSI 156.10.

4 SETUP



STEP OUT OF THE INFRARED FIELD!



SETUP 1 (QUICK)

reference picture

either hold the knob for 2 seconds, or use the remote control buttons as specified



SETUP 2 (ASSISTED)

test of full door cycle + reference picture



either hold the knob for 4 seconds, or use the remote control buttons as specified




TEST THE PROPER OPERATION OF THE INSTALLATION BEFORE LEAVING THE PREMISES!

LED SIGNALS

COLORS



BEHAVIORS



BASIC

	0	1	2	3	4	5	6	7	8	9	
Back More											
RAD: FIELD SIZE	small	>	>	>	>	>	>	>	>	large	
RAD: SHAPE	LCD: "narrow" and "wide" setting options (default = wide) Remote Control: = wide, = narrow										
AIR: WIDTH											see note 1
AIR: OUTPUT		DeEner/NO NC	Energ/NC NO	Energ/NC NC	DeEner/NO NO						see note 2
TEST	off	on	on+auto								see note 3
More Back											
Back More											
RAD: FIELD SIZE	small	>	>	>	>	>	>	>	>	large	
RAD: IMMUNITY		low	>	>	>	>	>	>	>	high	
RAD: DIRECTION	off	bi	uni	MTF					uni + reentry		see note 4
RAD: HOLD TIME	auto	1 s	2 s	3 s	4 s	5 s	6 s	7 s	8 s	9 s	see note 5
RAD: REENTRY	small	>	>	>	>	>	>	>	>	large	see note 2
RAD: OUTPUT		DeEner/NO NC	Energ/NC NO	Energ/NC NC	DeEner/NO NO						see note 2
AIR: IMMUNITY		normal	enhanced					mode B			see note 1
AIR: WIDTH											see note 1
AIR: NUMBER		1	2								
AIR: PRESENCE TIME			30 s	1 min	2 min	5 min	10 min	20 min	60 min	infinte	
AIR: FREQ		A	B								
AIR: OUTPUT		DeEner/NO NC	Energ/NC NO	Energ/NC NC	DeEner/NO NO						see note 2
TEST	off	on	on+auto								see note 3
REDIRECTION	R1 MW R2 IR	R1 MW or R2 IR									see note 6
FACTORY RESET									full reset	partial reset	see note 7

ADVANCED

DIAGNOSTICS

factory value motion (green) presence (red)

ZIP CODE ID # CONFIG P/N SOFT P/N ERROR LOG AIR: SPOT VIEW AIR: C1 ENERG AIR: C2 ENERG POWERSUPPLY OPERATINGTIME

all parameter settings in zipped format (see application note on ZIP CODE – 76.0024) unique ID-number

Download the BEA DECODER app for a quick overview of settings



last 10 errors + day indication
 view of spot(s) that trigger detection
 signal amplitude received on curtain
 signal amplitude received on curtain 2
 supply voltage at power connector
 power duration since first startup

RESET LOG delete all saved errors
 PASSWORD LCD and remote control password (0000= no password)
 ADMIN enter code to access admin mode

OVERVIEW OF SETTINGS (cont.)

Note 1	Always use a screwdriver when making further AIR adjustments to the arrow position on the sensor.	
Note 2	RADAR	AIR
	NO = normally open NC = normally closed DeEner = de-energized relay (active) Ener = energized relay (passive)	NO = normally open NC = normally closed
Note 3	The sensor LED will briefly flash RED during monitoring communication with door control. This indicates that external monitoring is functional. Monitoring functionality must be active on the sensor and door control, and monitoring wires must be properly connected to the door control.	
Note 4	MTF = uni-directional with motion-tracking feature uni + reentry: BEA recommends only adjusting using the LCD	
Note 5	Auto mode evaluates traffic rate and adjusts hold time from 0.5 to 3 seconds	
Note 6	REDIRECTION setting (F1 on remote control):	
	R1-MW, R2-IR (f1=0): R1 = MW (i.e. motion detection) R2 = IR (i.e. presence detection)	R1-MW or IR, R2-IR (F1=1): R1 = MW or IR (i.e. motion or presence detection) R2 = IR (i.e. presence detection)
Note 7	partial: outputs are not reset	

TECHNICAL SPECIFICATIONS

Output:	Relay 1	Relay 2
	Electromechanical relay (potential and polarity free) Max. contact current: 1 A Max. contact voltage: 30 VAC Adjustable hold time: 0.5 – 9 s	Solid-state relay (potential and polarity free) Max. contact current: 100 mA Max. contact voltage: 42 VDC / 30 VAC
Test/Monitoring input:	Sensitivity: Low: < 1 V High: > 10 V (max. 30 V)	
Supply voltage:	12 – 24 VAC ±10% 12 – 30 VDC ±10% to be operated from SELV-compatible power supplies only	
Voltage regulator (camera harness):	6.6 – 36 VDC (±10%) 6 – 28 VAC (±10%)	
Mounting height:	6'6" – 11'6" local regulations may impact acceptable mounting height (pedestrian applications only)	

*Specifications are subject to change without prior notice.
All values measured in specific conditions.*

BEA, INC. INSTALLATION/SERVICE COMPLIANCE EXPECTATIONS

BEA, Inc., the sensor manufacturer, cannot be held responsible for incorrect installations or incorrect adjustments of the sensor/device; therefore, BEA, Inc. does not guarantee any use of the sensor/device outside of its intended purpose.

BEA, Inc. strongly recommends that installation and service technicians be AAADM-certified for pedestrian doors, IDA-certified for doors/gates, and factory-trained for the type of door/gate system.

Installers and service personnel are responsible for executing a risk assessment following each installation/service performed, ensuring that the sensor/device system performance is compliant with local, national, and international regulations, codes, and standards.

Once installation or service work is complete, a safety inspection of the door/gate shall be performed per the door/gate manufacturer's recommendations and/or per AAADM/ANSI/DASMA guidelines (where applicable) for best industry practices. Safety inspections must be performed during each service call – examples of these safety inspections can be found on an AAADM safety information label (e.g. ANSI/DASMA 102, ANSI/DASMA 107, UL294, UL325, and International Building Code).

Verify that all appropriate industry signage, warning labels, and placards are in place.



Tech Support: 1-800-407-4545 | Customer Service: 1-800-523-2462
General Tech Questions: techservices-us@BEAsensors.com | www.BEAsensors.com

A Halma company