


Input 1 and Input 2 are activation inputs for Door 1 and Door 2 respectively

Inputs 3 and 4 are for the DPSs for door 1 (input 3) and door 2 (input 4) respectively. Switch is closed when door is closed.

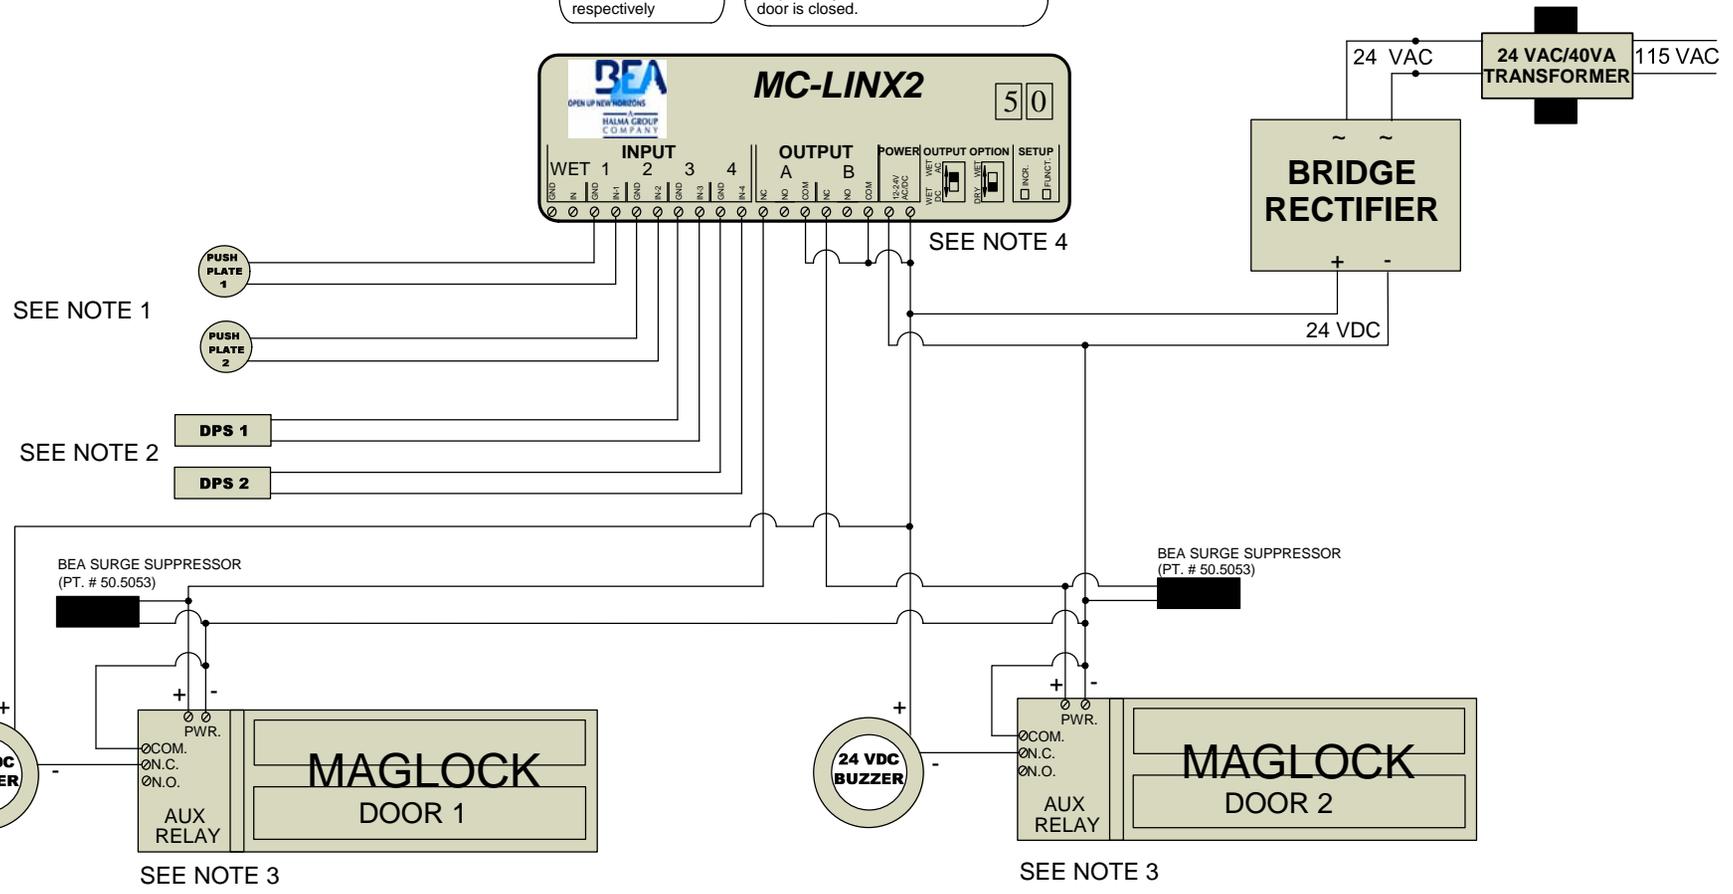

- DPS = Door position switch
- NOTES:
- 1) PUSH PLATES ARE DRY CONTACT NORMALLY OPEN SWITCHES
  - 2) DOOR POSITION SWITCHES ARE NORMALLY CLOSED SWITCH IS CLOSED WHEN DOOR IS CLOSED.
  - 3) MAGLOCK AUXILIARY RELAY CONTACTS WILL BE OPEN WHEN LOCK IS POWERED AND BONDED
  - 4) SET OUTPUT OPTION ON MCLINX2 TO DRY. REMOVE POWER BEFORE CHANGING.

IF AFTER TROUBLESHOOTING A PROBLEM, A SATISFACTORY SOLUTION CANNOT BE ACHIEVED, PLEASE CALL B.E.A., INC. FOR FURTHER ASSISTANCE DURING EASTERN STANDARD TIME AT 1-800-523-2462 FROM 8AM - 5PM. FOR AFTER-HOURS, CALL EAST COAST: 1-866-836-1863 OR 1-800-407-4545 / MID-WEST: 1-888-308-8843 / WEST COAST: 1-888-419-2564. DO NOT LEAVE ANY PROBLEM UNRESOLVED. IF YOU MUST WAIT FOR THE FOLLOWING WORKDAY TO CALL B.E.A., LEAVE THE DOOR INOPERABLE UNTIL SATISFACTORY REPAIRS CAN BE MADE. NEVER SACRIFICE THE SAFE OPERATION OF THE AUTOMATIC DOOR OR GATE FOR AN INCOMPLETE SOLUTION.WEB: WWW.BEASENSORS.COM

			
100 ENTERPRISE DRIVE PITTSBURGH, PA 15275 PHONE: (412) 249-4100 FAX: (412) 249-4101 EMAIL: www.beasensors.com			
<b>TITLE: MC-LINX2 TWO MANUAL DOORS INTERLOCKED W/ MAGLOCKS AND BUZZERS</b>			
SIZE:	DRAWN BY:	REV BY:	PART NO:
A	WJR		80.0301.00
	SCALE:	DATE:	SHEET
	NONE	10 DEC. 2008	1 OF 1